



MC242 & MC242X1 CONTROLLER

INSTRUCTION BOOK

Please take your time to read this Instructions book in order to understand the safe and correct use of your new Bibby Scientific product.

It is recommended the Responsible Body for use of this equipment reads this Instruction book and ensures the user(s) are suitably trained in its operation.

CONTENTS

Section 1	Introduction	Page 3
Section 2	Symbols and using this Instruction book	Page 4
Section 3	Safety Information.	Page 5
Section 4	Unpacking and contents	Page 7
Section 5	Installation	Page 8
Section 6	Environmental Protection.	Page 9
Section 7	Product Operation.	Page 10
Section 8	Technical Specification.	Page 12
Section 9	Maintenance	Page 13
Section 10	Customer Support	Page 18
Section 11	Spares and Accessories	Page 20
Section 12	Notes	Page 21
Section 13	EC declaration of Conformity	Page 24
Appendix A	Decontamination Certificate.	Page 19

© The copyright of this instruction book is the property of Bibby Scientific Limited. This instruction book is supplied by Bibby Scientific Limited on the express understanding that it is to be used solely for the purpose for which it is supplied. It may not be copied, used or disclosed to others in whole or part for any purpose except as authorised in writing by Bibby Scientific Limited. Bibby Scientific Limited reserves the right to alter, change or modify this document without prior notification.

In the interest of continued development Bibby Scientific Limited reserve the right to alter or modify the design and /or assembly process of their products without prior notification.

This product is manufactured in Great Britain by Electrothermal, part of the Bibby Scientific Group of companies.

1. INTRODUCTION:

- 1.1. The MC242 Controller has been designed to provide a comprehensive answer to control the heating of resistive loads such as Heating Mantles, Heating Tapes and Cords.
- 1.2. The MC242 is supplied with a mains output lead with an IEC socket to connect it to the resistive load.
- 1.3. The MC242 is supplied with a rod support clamp at the rear of the controller to take a standard 12.5mm (1/2") diameter rod.
- 1.4. MC242 is a 230V~AC Controller. The MC242X1 is a 115V~AC Controller.

2. SYMBOLS AND USING THIS INSTRUCTION BOOK.

- 2.1. Throughout this Instruction book the following symbols are shown to identify conditions which pose a hazard to the user, or to identify actions that should be observed. These symbols are also shown on the product, or its packaging. When a symbol is shown next to a paragraph or statement it is recommended the user takes particular note of that instruction in order to prevent damage to the equipment or to prevent injury to one's self or other people.

The Responsible Body and the Operator should read and be familiar with this Instruction book in order to preserve the protection afforded by the equipment.

To prevent injury or equipment damage it is the manufacturer's recommendation that all persons using this equipment are suitably trained before use.

2.2. Symbols Defined.



Caution, risk of danger. See note or adjacent symbol.



Protective conductor terminal to be earthed.
(Do not loosen or disconnect).



Caution / risk of electric shock.



Recyclable Packing Material.



Do not dispose of product in normal domestic waste.



Caution. Hot surface.



Refer to instructions book.



Bio Chemical Hazard. Caution required. Will require decontamination.

3. SAFETY INFORMATION.

This product has been designed for safe operation when used as detailed in accordance with the manufactures instructions.

NOTE: Failure to use this equipment in accordance with the manufactures operating instructions may compromise your basic safety protection afforded by the equipment and may invalidate the warranty / guarantee. The warranty / guarantee does not cover damaged caused by faulty installation or misuse of the equipment.

3.1. Prevention of Fire and Electric shock.



To prevent a risk of fire or electric shock, **DO NOT** open your product case without authorisation. Only qualified Service personnel should attempt to repair this Controller.



Replace fuses only with the type as listed in section, Parts and Accessories and Technical Specifications. (See fuse type and rating).



Ensure the Mains Power Supply conforms to rating found on the data plate located on the base of this product.



Never Operate this equipment with out connection to earth / ground. Ensure the mains supply voltage is correctly earthed / grounded in accordance with current area legislation.



Do not install or remove any heating apparatus from the controller whilst power is applied.

3.2. General safe Operating Practice.



Always follow good laboratory practice when using this equipment. Give due recognition to your company's safety and legislative health & safety procedures and all associated legislation applicable to your areas of operation. Check laboratory procedures for substances being heated and ensure all hazards (e.g. explosion, implosion or the release of toxic or flammable gases) that might arise have been suitably addressed before proceeding. When heating certain substances the liberation of hazardous gases may require the use of a fume cupboard or other means of extraction.



Ensure equipment is used on a clean, dry, non-combustible, solid work surface with at least 300mm suitable clearance all around from other equipment.



Do not position the product so that it is difficult to disconnect from the mains supply.



Do not immerse unit in water or fluids.



Do not spill substances onto this unit. If spillage does occur, disconnect unit from mains supply and follow instructions as detailed in Section 'Maintenance'.



To prevent electronic overhear and potential fire
Do not cover this product when connected to the mains power supply.



Do not obstruct the ventilation slots in the controller base.



It is **not** recommended to leave any heating apparatus unattended during operation.



Only use Original Equipment manufacture's spares and accessories. Ref Section 10.



The equipment is not spark, flame or explosion proof and has not been designed for use in hazardous areas in terms of BSEN 60079-14:1997. Keep flammable, low flash point substances away from heating apparatus.



Do not operate or handle any part of this product with wet hands.



Do not leave this product switched on without glass sides in place for prolonged periods.



Keep the Mains Plug and Lead set cable away from the heating apparatus being controlled.



Refer to Instructions book / product data label for the resistive load of equipment to ensure controller is suitable for application.




Always observe the Manufactures operating and safety instructions for the equipment to be connected to the controller.

NOTE: *if this product is not used in accordance with the Manufacturers Instructions then the basic safety protection afforded by the equipment may not be preserved and the guarantee invalidated.*

4. UNPACKING AND CONTENTS.

- 4.1. Please check the contents of your carton against the diagram.
(Please note MC242x1 has a hard wired input).

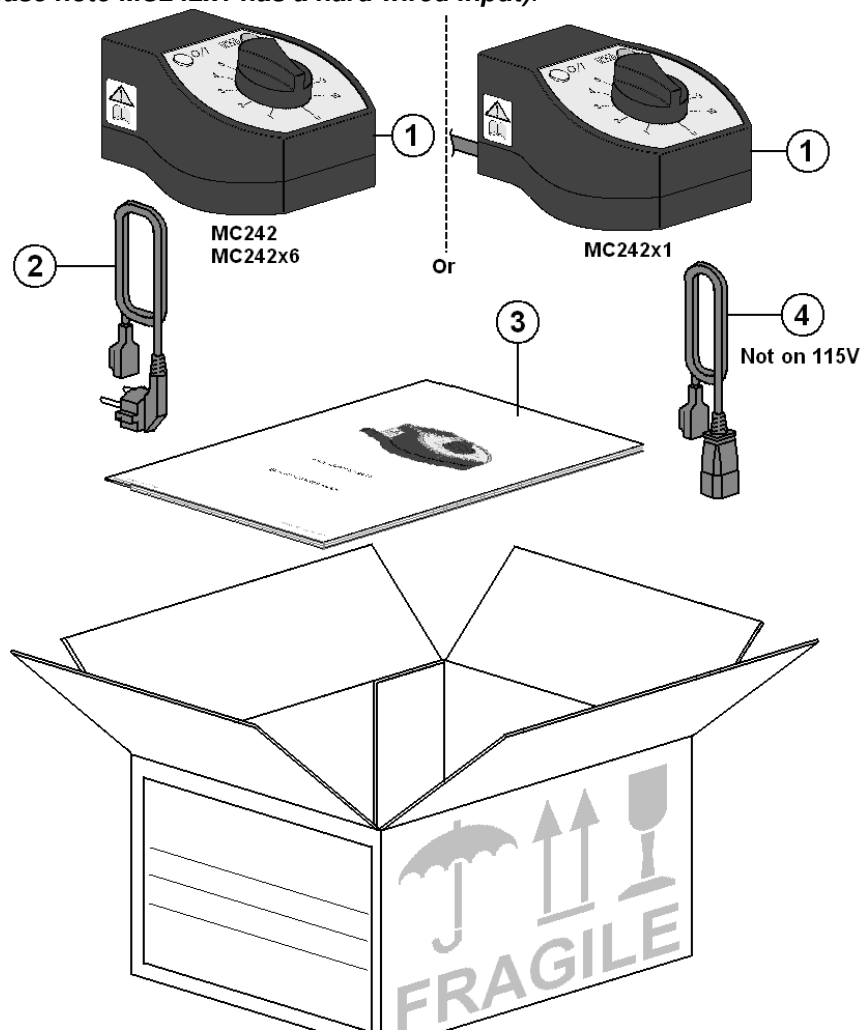

(Illustration only)

Contents.

Item	Description	Qty
1	MC242 Control unit	1
2	Moulded mains cord and plug set. (Input)	A/R
	Note: x1 variant hard wired	
3	Instructions book (this document).	1
4	Moulded mains cord and socket set (Output). Not on 115V	1


For future reference please record your products Serial and Model Numbers.	Serial Number	Model Number

5. INSTALLATION

5.1. Electrical safety and installation.

5.2. This equipment is designed to safe under the following conditions:-

- Indoor use.
- Altitude up to 2000 meters.
- Temperatures between 5°C and 40°C.
- Maximum relative humidity 80% for temperatures up to 31°C decreasing linearly to 50% relative humidity at 40°C.
- Mains supply voltage fluctuations up to $\pm 10\%$ of the nominal voltage.
- Transient overvoltage's typically present on the mains supply (Overvoltage Category II)
- Applicable rated pollution degree 2.

5.3.  This equipment must be earthed / grounded to a fixed earth / grounded mains socket outlet. The mains supply is to be earthed / grounded in accordance with current legislation.


5.4. Ensure only the correct rated mains input fuses are fitted. (Where applicable ensure the correct mains cable fuse if fitted). See Technical Information Section 8 of this Instruction book.

5.5. Check the voltage on the product data label of this unit. Ensure the rating conforms to your local supply. If an 115V product is used in a 230V supply area, then a 230/115V transformer must be installed between the 230V mains supply and the product, by a competent electrician.

Only connect controller to resistive loads. Refer to section 8.

5.6. It is recommended this unit be connected to a mains supply source which incorporates an RCD or GFCI device.

The unit is supplied with a moulded mains cord and plug set wired as follows:-

	Green / Yellow	or	Green	=	Earth / Ground
	Blue	or	White	=	Neutral
	Brown	or	Black	=	Live / line hot.

5.7. If the controller is to be used on a retort rod, make sure it isn't positioned over any heating apparatus.

6. ENVIRONMENTAL PROTECTION

- 6.1. Maximum consideration has been given to environmental issues within the design and manufacturing process without compromising end product performance and value.



- 6.2. Packaging materials have been selected such that they may be sorted for recycling.



- 6.3. At the end of your product and accessories life, it must not be discarded as domestic waste. Ref: EU Directive 2002/96/EC on Waste Electrical and Electronic Equipment Directive (WEEE). Please contact your distributor / supplier for further information. For end users outside of the EU consult applicable regulations.

- 6.4. This product should only be dismantled for recycling by an authorised recycling company.




This product and accessories must be accompanied by a completed Decontamination Certificate prior to any disposal. Copies of the Certificate are available from your distributor of Bibby Scientific products, or you may copy and enlarge from 'Appendix A' of this instruction book.

Bibby Scientific's Electrothermal branded product range is registered with the Environment Agency under the name of as Electrothermal Engineering Limited as being a producer of WEEE (Waste Electronic and Electrical Equipment) through b2b Compliance, an authorised waste collection compliance scheme.


7. EQUIPMENT OPERATION.

7.1. The illustrations below show detailed layout of the MC242 control unit.

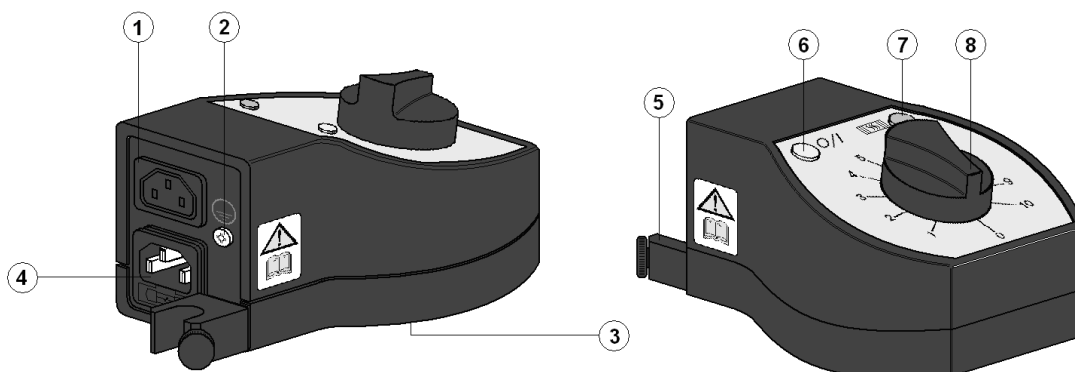

230V illustration

- 1 Mains Output IEC socket.
- 2 Earth continuity test point
- 3 Dataplate label. **(See for correct voltage type).**
- 4 IEC mains input socket
- 5 Rod support clamp.
- 6 Mains power on neon lamp. **(White).**
- 7 Mantle / Bunsen heaters on neon lamp. **(Amber).**
- 8 Regulator control knob.

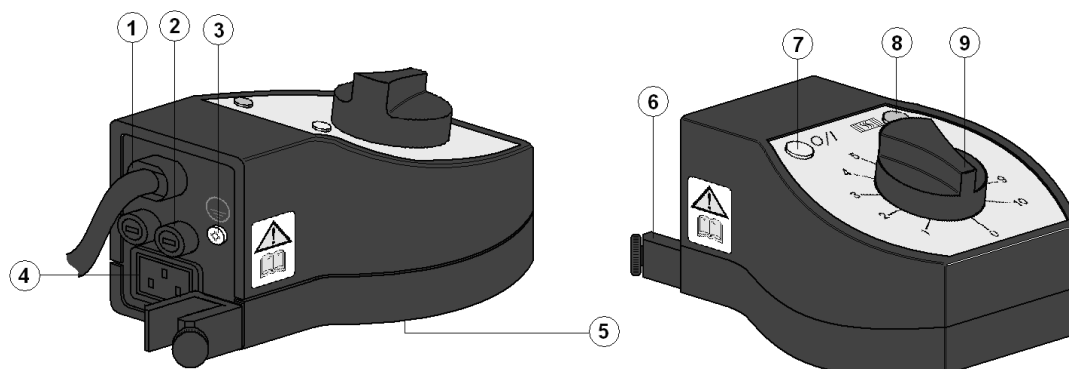


115V illustration(x1 variant).

- 1 Mains Input Cable
- 2 Mains Fuse
- 3 Earth continuity test point
- 4 Mains Output IEC socket.
- 5 Dataplate label. **(See for correct voltage type).**
- 6 Rod support clamp
- 7 Mains power on neon lamp. **(White).**
- 8 Mantle / Bunsen heaters on neon lamp. **(Amber).**
- 9 Regulator control knob.

Check the Dataplate label and ensure your mains electrical supply voltage is compatible with this product.

7.2. Connect the IEC output plug to your heating apparatus product as illustrated.

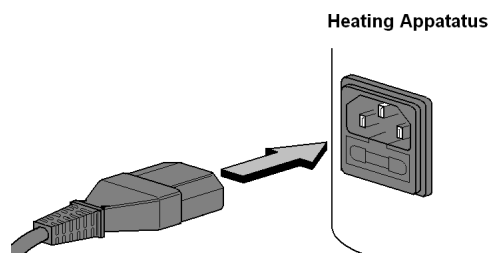

7.3. Connect the other end to your MC controller.

7.4. Connect to the mains electricity supply. Observe the white neon lamp is illuminated showing the presence of mains electricity.

7.5. Switch the controller on by turning the regulator control knob clockwise to increase power. The amber neon lamp on the controller will pulsate to show that power is being supplied to the mantel, heating tape or cord etc. The frequency of the pulse will increase as the regulator control knob setting is increased. At maximum setting the amber neon will be continually illuminated.

7.6. When your process is complete, switch off the controller and disconnect it from the mains electricity supply.



Always take suitable handling precautions when moving / touching hot glass vessels and solutions.



7.7. **For safe operating practice always refer to the Instruction book of the equipment being used.**

8. TECHNICAL SPECIFICATION.

8.1. Specifications.


Mains supply voltage MC242	230V~AC 50/60 Hz
Mains supply voltage MC242X1	115V~AC 50/60 Hz
Maximum coupled power consumption	230V – 1800 watts 115V – 1150 Watts
Controller power consumption	<1 Watt.
Fuse rating at 230V	10A 5x20mm Glass Quick blow.
Fuse rating at 115V	12.A 32x6mm Quick Blow
Mains cord and moulded IEC plug and lead set cable (UK) 13A BS1362 AZ9165	3 core earthed / ground. 2 meters long Moulded IEC plug and Lead set – supply cord H05 V V-F- Replace only with equivalent cable.
Mains cord and moulded IEC plug and lead set cable (Europe) AZ6747	3 core earthed / ground. 2 meters long Moulded IEC plug and Lead set – supply cord H05 V V-F- Replace only with equivalent cable.
Mains cord and moulded IEC plug and lead set cable (USA) AZ6746	3 core earthed / ground. 2 meters long Moulded IEC plug and Lead set – supply cord SJT VW 1- 105° Replace only with equivalent cable.
Lead set plug fuse (UK – only)	13A BS1362
Moulded Mains Output Power cord and lead set	3 core earthed / ground. 2 meters long Moulded IEC plug / socket lead set. H05-V-VF. Replace only with equivalent cable.
Clamps for support rods.	½" (12.7mm) dia (max).

The Ingress Protection rating for this product is classified as IPX 0.



Do not allow this product to come into contact with liquid.

8.2. Dimensions & weight (unpacked).

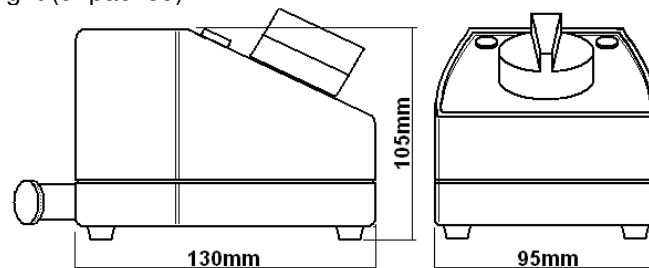

Weight 0.42 Kg

9. MAINTENANCE.

9.1. General information.



Unplug the unit from the mains voltage supply and allow it to cool before undertaking any maintenance tasks.



Maintenance should only be carried out under the direction of the Responsible Body, by a competent electrician. Failure to do so may result in damage to the product and in extreme cases be a danger to the end user.

With proper care in operation this equipment has been designed to give many years of reliable service. Contamination or general misuse will reduce the effective life of this product and may cause a hazard.

Maintenance for the unit should include:


- Periodic electrical safety testing (an annual test is recommended as the minimum requirement).
- Regular inspection for damage with particular attention to the mains lead and plug set.
- Routine cleaning of the equipment should be undertaken using a clean cloth.
- Check the ventilation slots are clear.

DO NOT USE SOLVENTS FOR CLEANING ANY PART OF THIS EQUIPMENT.

9.2. Replacing controller fuses.


MC242 (230V)

The mains fuse holder is located at rear your product. Refer to Technical Specification, 'Fuse Rating' for correct fuse type and rating. Turn your product off and remove it from the mains supply. Open fuse draw and remove fuses. Fit replacement fuses and close the draw.

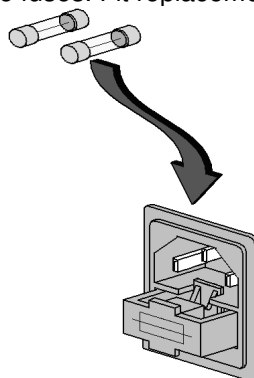


MC242X1 (115V)

① Unscrew both fuse holder caps from the fuse housings and ② remove the fuses. Fit replacement fuses of the correct rate and value (see section 11 – Spares and accessories).

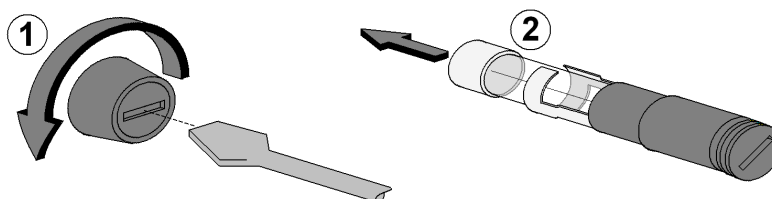


9.3. Replacing the Energy Regulator.


9.3.1. Remove the energy regulator knob by pulling in a vertical direction away from the unit.

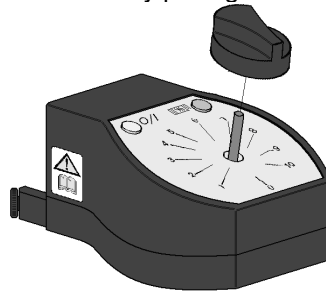



9.3.2. Remove and retain the regulator spindle locknut and shakeproof washer.

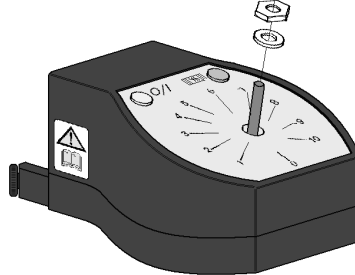

9.3.3. Turn the controller up-side down and remove the two fixing screws retaining the base. Lift the base off.

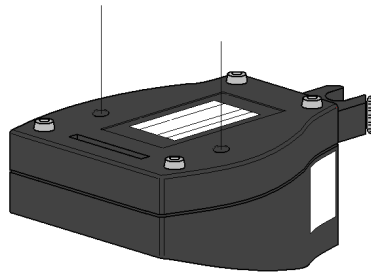

9.3.4. Disconnect the tagged wires one at a time from old and connect to the new energy regulator. Refer to wiring diagram.

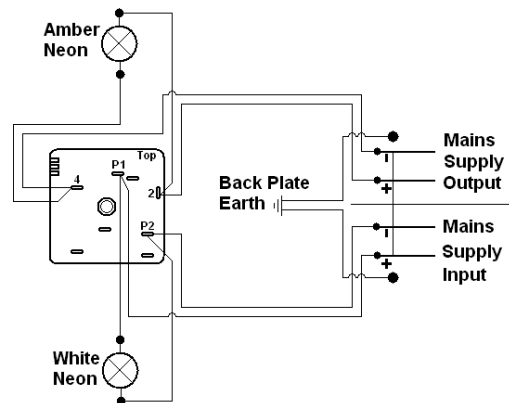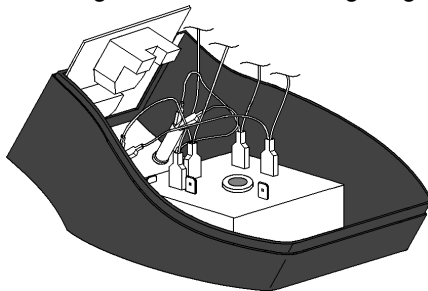

Reassemble.

9.3.5. Position new energy regulator then fit and tighten the shakeproof washer and locknut.

9.3.6. Replace the energy regulator control knob ensuring the flat on surface on the energy regulator spindle is aligned.


9.3.7. Replace the base and refit the two fixing screws.

The responsible body shall check the electrical safety of the unit before further use.


9.4. Replacing a Neon.

9.4.1. Turn your product off and remove it from the mains supply. Disconnect it from any heating resistive loads such as Heating Mantles, Heating Tapes and Cords.

9.4.2. Turn the Controller up-side down and remove the two fixing screws retaining the base. Lift the base off.

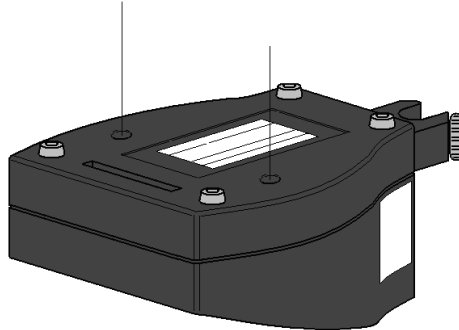

9.4.3. Disconnect the two wires from the neon.

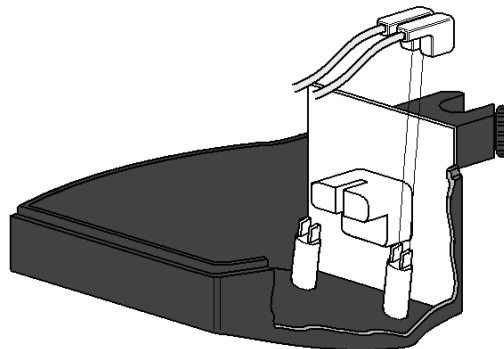

9.4.4. Push the neon out from the inside. Note a slight twisting movement may be necessary.

Reassemble.

9.4.5. Insert the new neon ensuring the tags align with the other neon.

9.4.6. Reconnect the tags.


9.4.7. Replace the base and refit the two securing screws.

The responsible body shall check the electrical safety of the unit before further use.


9.5. Replacing the Controller Output lead.

9.5.1. Turn your product off and remove it from the mains supply. Disconnect it from any heating resistive loads such as Heating Mantles, Heating Tapes and Cords.

9.5.2. Turn the controller up-side down and remove the two fixing screws retaining the base. Lift the base off.

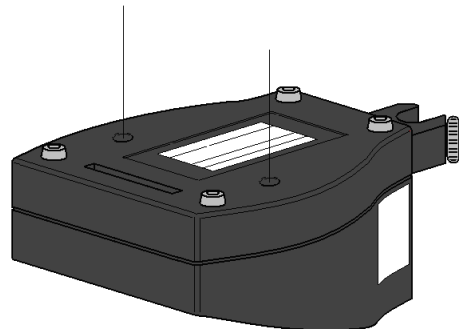


- 9.5.3. Remove and retain the stiff nut / washer etc, on the earth post and disconnect the earth wire.

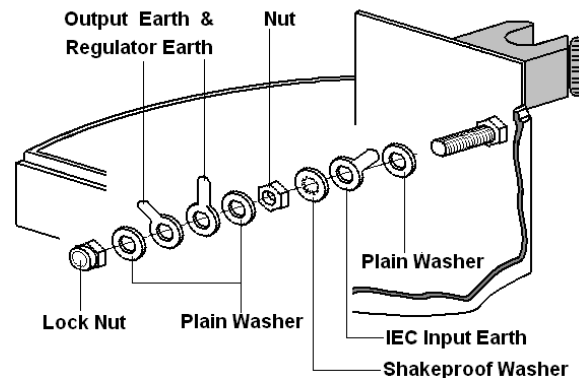

- 9.5.4. Disconnect the mains out cable wires from the PCB assembly.
- 9.5.5. Squeeze the retaining relief bush's rounded section and push the strain relief bush from inside.
- 9.5.6. Remove the Mains output cable.
- 9.5.7. Relocate the strain relief bush around the new Mains output cable with the smaller diameter towards and approximately 10mm from end of the cable outer sleeve.
- 9.5.8. Squeeze the bush and align the flats to locate through the aperture in the back plate.
Note a reasonable amount of force may be required.
- 9.5.9. Check the fitting by pulling on the output mains cable while holding the back plate.
- 9.5.10. Locate the earth wire ring tag on the earth post and refit the stiff nut.

Note: Only replace with rated cable type specified in section 8.1. The cable contains an earth ring and insulated connection tags crimped on and tested by the manufacture. See section Parts and Accessories to order replacement cable.

- 9.5.11. Reconnect the mains and neutral wires from the cable to the PCB. (**See wire diagram**).

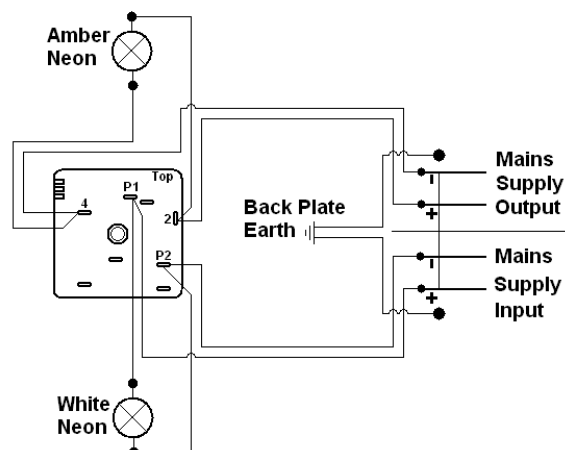

- 9.5.12. Replace the base and refit the two securing screws.

The responsible body shall check the electrical safety of the unit before further use.

9.6. Spillage and Decontamination.

In the event of spillage switch off and unplug this product from the mains electrical supply. Wipe off all excess liquid from the product and surrounding area using an absorbent soft cloth. Allow sufficient time for any ingressed liquid to evaporate before commencing with use.

If in doubt please consult Customer Support. Refer to section 10.



If the equipment has been exposed to contamination, the Responsible Body is responsible for carrying out appropriate decontamination. If hazardous material has been spilt on or inside the equipment, decontamination should only be undertaken under the control of the Responsible Body with due recognition of possible hazards. Before using any cleaning or decontamination method, the Responsible Body should check with the manufacturer the proposed method will not damage the equipment.

Prior to further use, the Responsible Body shall check the electrical safety of the unit. Only if all safety requirements are met can the unit be used again. The above procedure is intended as a guide. Should spillage occur with a toxic or hazardous fluid then special precautions may be necessary.

Decontamination Certificate.

Note: In the event of this equipment or any part of the unit becoming damaged, or requiring service, the item(s) should be returned to the manufacturer for repair accompanied by a decontamination certificate. **Copies of the Certificate are available from Distributor/Manufacturer. Appendix A of this instructions book may be copied and enlarged.**

At the end of life, this product must be accompanied by a Decontamination Certificate. See section 6.3 and 6.4

10. CUSTOMER SUPPORT

For help and support in using this product, please contact Customer Services at the following address.

Bibby Scientific Limited.

Beacon Road,
Stone,
Staffordshire ST15 0SA,
Great Britain.

Tel: +44(0)1785 812121
Fax: +44(0)1785 810405

- General enquiries :
info@bibby-scientific.com
- Order enquiries :
sales@bibby-scientific.com
- Technical support :
electrothermalhelp@bibby-scientific.com
- www.electrothermal.com

For the America's and Canada, contact:

Techne Incorporated, 3 Terri Lane,
Suite 10 Burlington, NJ 08016 USA.

Toll free: 800-225-9243 Tel: 609-589-2560
Fax: 609-589-2571
Email: labproducts@techneusa.com
Http www.techneusa.com

APPENDIX 'A'. DECONTAMINATION CERTIFICATE.

Bibby Scientific Limited. Beacon Road, Stone, Staffordshire ST15 0SA. Great Britain Tel: +44(0)1785 812121. Fax: +44(0)1785 810405 E-mail: electrothermalhelp@bibby-scientific.com		
<u>DECONTAMINATION CLEARANCE CERTIFICATE</u>		
For the Inspection, Repair or Return of Medical, Laboratory or Industrial Equipment. Prior to a Service Engineer working on equipment that has been in an environment where substances hazardous to health may have been used, you are requested to provide the following information:		
CUSTOMER DETAILS		
Company:-	Address:-	
Department:-		
Contact Name:-		
Tel No:-		
Fax No:-	Post Code:-	
<u>Product Description</u>		
Model No:-	Serial No:-	
Has the equipment been exposed to any of the following. Please answer all questions by deleting YES/NO as applicable and by providing details in section 2 below.		
A. Blood, body fluids, Pathological specimens	YES/NO	Provide details if YES
B. Biodegradable material that could become a hazard	YES/NO	Provide details if YES
C. Other biohazard	YES/NO	Provide details if YES
D. Chemical or substances hazardous to health	YES/NO	Provide details if YES
E. Radioactive substances State name(s) and quantities of isotopes and checks made for residual activity	YES/NO	Provide details if YES
F. Other hazards	YES/NO	Provide details if YES
2. Please provide details of any hazard present as indicated above. Include details of names and quantities of agents as appropriate:-		
3. Your method of decontamination (please describe):-		
4. Are there likely to be any areas of residual contamination (please specify)		
I declare that the above information is true and complete to the best of my knowledge and belief.		
Authorised signature:-	Name (please print):-	
Title/Position:-		
For and behalf of:-	Date:-	

11.SPARES AND ACCESSORIES.

Order Number	Description.	Qty
Neon (230V) Clear	CRM5607	1
Neon (230V) Amber	CRM5606	1
Neon (115V) Clear	CRM5619	1
Neon (115V) Amber	CRM5620	1
Fuse (230V) F10A	AZ9034	10
Fuse (115V) F12.5A	AZ9065	10
Energy Regulator (230V)	CRM5736	1
Energy Regulator (115V)	CRM5737	1
Mains cord and moulded IEC plug and lead set (UK) 230V ~ AC	AZ9165	1
Mains cord and moulded IEC plug and lead set (USA) 115V ~ AC	AZ6746	1
Mains cord and moulded IEC plug and lead set (Europe) 230V ~ AC	AZ6747	1

12. NOTES.

13. EC DECLARATION OF CONFORMITY.

CE marked products and associated accessories covered by this Instruction book conform to the essential requirements of the following directives:

EMC Directive.

Low Voltage Directive.



Thank you for reading this data sheet.

For pricing or for further information, please contact us at our UK Office, using the details below.



UK Office

Keison Products,

P.O. Box 2124, Chelmsford, Essex, CM1 3UP, England.

Tel: +44 (0)330 088 0560

Fax: +44 (0)1245 808399

Email: sales@keison.co.uk

Please note - Product designs and specifications are subject to change without notice. The user is responsible for determining the suitability of this product.