



## **PARAFFIN SECTION FLOTATION BATH**

**MH8517 MH8517/x1**

### **INSTRUCTION BOOK**

**Please take your time to read this Instructions book in order to understand the safe and correct use of your new Bibby Scientific product.**

**It is recommended that the Responsible Body for use of this equipment reads this Instruction book and ensures the user(s) are suitably trained in its operation.**

## **CONTENTS**

<b>Section 1</b>	Introduction	<b>Page 3</b>
<b>Section 2</b>	Symbols and using this Instruction book	<b>Page 4</b>
<b>Section 3</b>	Safety Information.	<b>Page 5</b>
<b>Section 4</b>	Unpacking and contents	<b>Page 7</b>
<b>Section 5</b>	Installation	<b>Page 8</b>
<b>Section 6</b>	Environmental Protection.	<b>Page 9</b>
<b>Section 7</b>	Product Operation.	<b>Page 10</b>
<b>Section 8</b>	Technical Specification.	<b>Page 12</b>
<b>Section 9</b>	Maintenance	<b>Page 13</b>
<b>Section 10</b>	Customer Support	<b>Page 15</b>
<b>Section 11</b>	Spares and Accessories	<b>Page 17</b>
<b>Section 12</b>	Notes	<b>Page 18</b>
<b>Section 13</b>	EC declaration of Conformity	<b>Page 20</b>
<b>Appendix A</b>	Decontamination Certificate.	<b>Page 16</b>

*© The copyright of this instruction book is the property of Bibby Scientific Limited. This instruction book is supplied by Bibby Scientific Limited on the express understanding that it is to be used solely for the purpose for which it is supplied. It may not be copied, used or disclosed to others in whole or part for any purpose except as authorised in writing by Bibby Scientific Limited. Bibby Scientific Limited reserves the right to alter, change or modify this document without prior notification.*

*In the interest of continued development Bibby Scientific Limited reserve the right to alter or modify the design and /or assembly process of their products without prior notification.*

**This product is manufactured in Great Britain by Bibby Scientific Group of companies.**

## **1. INTRODUCTION.**

The MH8517 Paraffin section mounting bath is designed for use as a heated, distilled water floating out bath for the manipulation and location of paraffin wax sections onto glass slides.

The black PTFE coated interior gives a high contrast background for locating specimens.

The MH8517 Paraffin bath uses an electronic temperature controller with thermocouple sensor feedback designed to supply power to a silicon rubber mat heater in order to maintain accurate water temperatures. A self resetting over temperature cut out device is fitted as an integral part of the heater mat in order to protect against any over temperature conditions.

This product is supplied with an IEC moulded cord and lead set for ease of operation and the IEC socket houses protection fuses for both the live and neutral power supply lines. A White neon indicates the presence of power while the Amber neon indicates when the heater is in an 'on' state.

## 2. SYMBOLS AND USING THIS INSTRUCTION BOOK

2.1. Throughout this Instruction book the following symbols are shown to identify conditions which pose a hazard to the user, or to identify actions that should be observed. These symbols are also shown on the product, or its packaging. When a symbol is shown next to a paragraph or statement it is recommended the user takes particular note of that instruction in order to prevent damage to the equipment or to prevent injury to one's self or other people.

**To prevent injury or equipment damage it is the manufacturer's recommendation that all persons using this equipment are suitably trained before use.**

2.2. Symbols defined.



Caution, risk of danger. See note or adjacent symbol.



Protective conductor terminal to be earthed.  
**(Do not loosen or disconnect).**



Caution / risk of electric shock



Recyclable Packing Material



Do not dispose of product in normal domestic waste.




Caution. Hot surface.



Refer to Instruction book



This symbol adjacent to an indication lamp means mains power  
Off/On when lamp non-illuminated / illuminated



This symbol is used to identify the Bath Heater on Control and bath  
heater "ON" indicator.



Bio Chemical Hazard. Caution required. Will require decontamination.

### 3. SAFETY INFORMATION.

This product has been designed for safe operation when used as detailed in accordance with the Manufacturer's instructions.

**NOTE:** Failure to use this equipment in accordance with the manufacturer's instructions may compromise your basic safety protection afforded by the equipment and may invalidate the warranty / guarantee. The warranty / guarantee does not cover damaged caused by faulty installation or misuse of the equipment

#### 3.1. Prevention of Fire and Electric Shock.



To prevent a risk of fire or electric shock, **DO NOT** open your product case without authorisation. Only qualified Service personnel should attempt to repair this product.



Replace fuses only with the type as listed in section, 'Technical Specifications and Parts and Accessories' (See fuse type and rating).



Ensure the Mains Power Supply conforms to rating found on the data plate located on the back of this product.



**Never** Operate this equipment without connection to earth / ground. Ensure the mains supply voltage is correctly earthed / grounded in accordance with current area legislation.

#### 3.2. General Safe Operating Practice.



Always follow good laboratory practice when using this equipment. Give due recognition to your company's safety and legislative health & safety procedures and all associated legislation applicable to your areas of operation.



Only use this equipment for the purpose intended.



Ensure equipment is used on a clean, dry, non-combustible, solid work surface with at least 300mm suitable clearance all around from other equipment.



**Do not** position the product so that it is difficult to disconnect from the mains supply.



**Do not** lean or stretch over equipment.



**Do not** immerse unit in water or fluids.



**Do not** spill chemicals over this product. If spillage does occur, disconnect unit from mains supply and follow instructions as detailed in Maintenance. (Section 9).



**Do not** cover this equipment whilst in use or obstruct cooling vents.



**Do not** leave equipment switched on when empty.



It is not recommended to leave any heating apparatus unattended during operation.



Only use Original Equipment 'Manufacturer's Spares and Accessories'. Ref Section 11.




The equipment is not spark, flame or explosion proof and has not been designed for use in hazardous areas in terms of BSEN 60079-14:1997. Keep flammable, low flash point substances away from the apparatus.



**Do not** operate or handle any part of the product with wet hands.

## 4. UNPACKING AND CONTENTS

4.1. Please check the contents of your carton against the diagram.

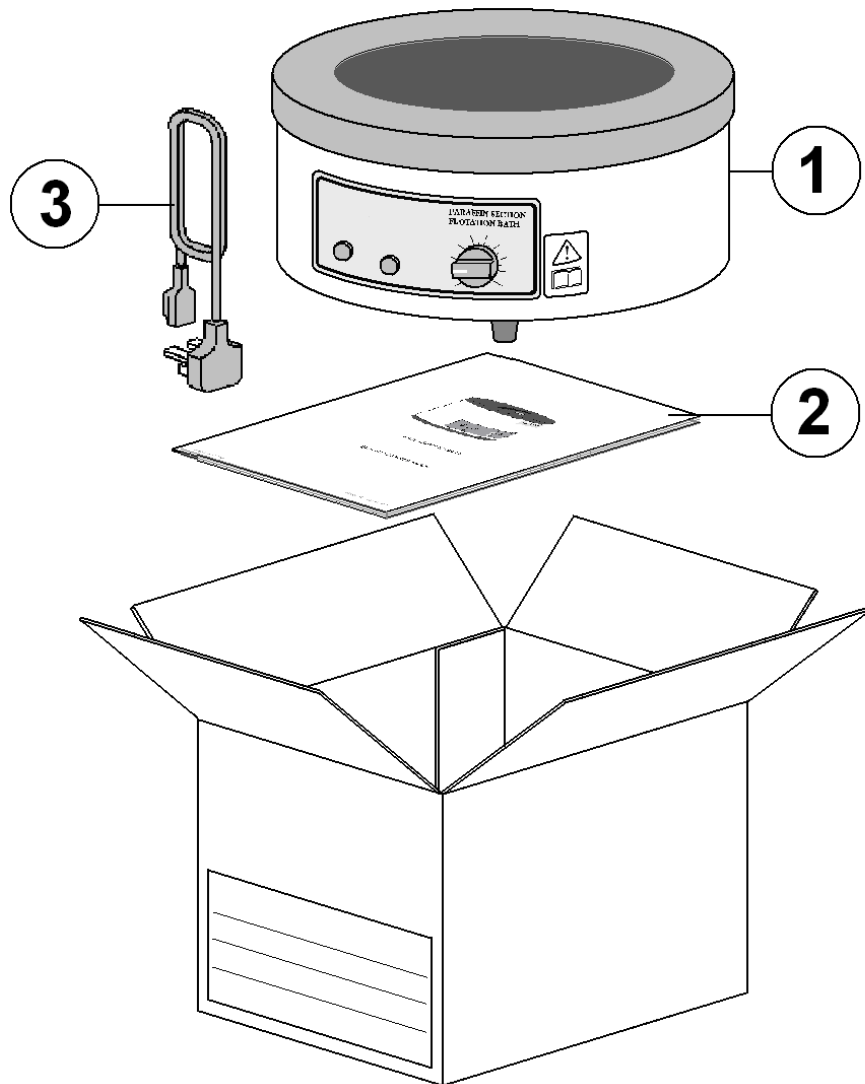

### Contents.

Item	Description	Qty
1	Paraffin Section Mounting Bath	1
2	Instruction book ( <i>this document</i> ).	1
3	Mains lead and moulded IEC plug set. <i>(Illustration may be different to lead set supplied depending on country of use).</i>	A/R

For future reference please record your products Serial and Model Number.	<b>Serial Number</b>	<b>Model Number</b>

## 5. INSTALATION

### 5.1. Electrical safety and installation.

5.1.1. This equipment is designed for safe use under the following conditions:-

- Indoor use.
- Altitude up to 2000 meters.
- Temperatures between 5°C and 40°C.
- Maximum relative humidity 80% for temperatures up to 31°C decreasing linearly to 50% relative humidity at 40°C.
- Mains supply voltage fluctuations up to  $\pm 10\%$  of the nominal voltage.
- Transient over voltages typically present on the mains supply.(Overvoltage category II).
- Applicable rated pollution degree 2.



5.2. This equipment must be earthed / grounded to a fixed earth / grounded mains socket outlet. The mains supply is to be earthed / grounded in accordance with current legislation.

5.3. Ensure only the correct rated mains input fuses are fitted. (Where applicable ensure the correct Mains cord and moulded IEC plug and lead set fuse if fitted). See Technical Specification Section 8 of this Instructions book.

5.4. Check the voltage on the product data label on this product unit. Ensure the rating conforms to your local supply.

5.5. It is recommended this product be connected to a mains supply source which incorporates an RCD or GFCI device.



5.6. Do not install this product or accessories on a surface which may become wet.

5.7. The unit is supplied with a Mains cord wired as follows:



<b>Green / Yellow</b>	<b>or</b>	<b>Green</b>	<b>=</b>	<b>Earth / Ground</b>
<b>Blue</b>	<b>or</b>	<b>White</b>	<b>=</b>	<b>Neutral</b>
<b>Brown</b>	<b>or</b>	<b>Black</b>	<b>=</b>	<b>Live / line hot.</b>



## 6. ENVIRONMENTAL PROTECTION.



- 6.1. Packaging materials have been selected such that they may be sorted for recycling.



- 6.2. At the end of your product and accessories life, it must not be discarded as domestic waste. Ref: EU Directive 2002/96/EC on Waste Electrical and Electronic Equipment Directive (WEEE). Please contact your distributor / supplier for further information. For end users outside of the EU consult applicable regulations.

- 6.3. This product should only be dismantled for recycling by an authorised recycling company.




***This product and accessories must be accompanied by a completed Decontamination Certificate prior to any disposal. Copies of the Certificate are available from your distributor of Bibby Scientific products, or you may copy and enlarge from 'Appendix A' of this instruction book.***

*Bibby Scientific's Electrothermal branded product range is registered with the Environment Agency under the name of as Electrothermal Engineering Limited as being a producer of WEEE (Waste Electronic and Electrical Equipment) through b2b Compliance, an authorised waste collection compliance scheme.*

## 7. PRODUCT OPERATION.

7.1. The Paraffin Bath has been designed for easy operation. The illustration below shows a detailed layout of the product.

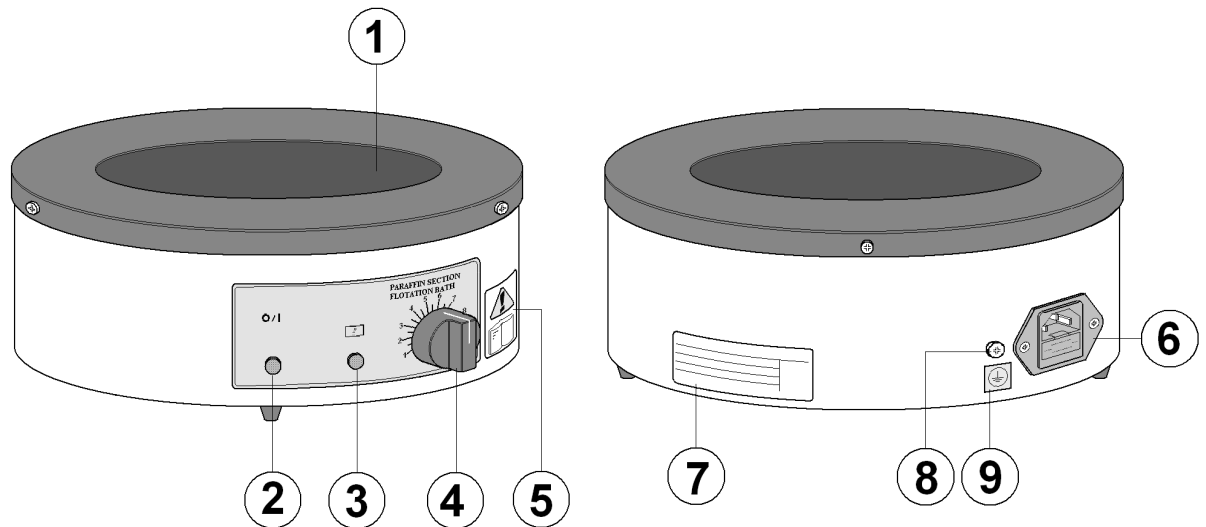

- 1 Bath tank
- 2 Mains power on neon (White).
- 3 Heater on neon. (Amber).
- 4 Temperature control regulation knob
- 5 Read instruction book label
- 6 Mains IEC plug socket and protection fuses
- 7 Data plate label
- 8 Earth bonding test point.
- 9 Earth bonding point attention label.

7.2. With the unit disconnected from the mains electricity supply, fill the bath tank with 2 Litres of distilled water.

**Note:** For best operation of this equipment, fill the unit with sterilized distilled water. The acceptable resistivity range is 50K to 1 Megohms (conductivity 1 to 20 micro Siemens). The acceptable pH range is 7 to 9.

**Caution:** Using chlorinated tap water or additives that contain chlorine will void the manufacture warranty. Similarly, high purity (deionized) water that does not fall within a resistivity range of 50K to 1 Megohms and pH range of 7 to 9 will void the manufacture warranty. If you have any questions, please contact Customer support (see page 15 of this instruction book).

7.3. Plug the unit into the mains electrical supply. Observe the illumination of the White neon indicating the presence of power.

7.4. The control knob has a temperature scale from 30 to 70 °C.

Set the control knob to the required temperature

**Note:** *On initial start-up from cold, the amber neon will be on continuously and will subsequently switch on and off with reducing 'on' periods as the required temperature setting is approached.*

For more accurate temperature setting, check bath water temperature using a hand held thermometer or other suitable temperature measuring device and adjust the regulating knob as required.

- 7.5. If an over temperature condition occurs, the bath heater mat will turn off. Disconnect from the mains electricity supply and check there is sufficient distilled water in the bath. When the unit has cooled down the thermal cut out will reset and operation may recommence. If a lack of distilled water isn't the reason for the over temperature fault condition, refer to section 10 Customer support.

***Take care not to get hot distilled water onto hands /skin***

- 7.6. Regularly check the volume of distilled water present in the unit. Replenish as required.
- 7.7. An optional lid can be purchased which reduces evaporation of bath water – order part code AZ9241.


## 8. TECHNICAL SPECIFICATION.

### 8.1. Specifications.

<b>Mains Power Supply Voltage</b>	<b>MH8517</b> 230V – AC 50/60 Hz or <b>MH8517x1</b> 115V – AC 50/60 Hz as stated on the data plate label.
<b>Maximum Power Consumption</b>	240 Watt max at 230V 240 Watt max at 115V
<b>Operational temperature and performance.</b>	70°C nominal from ambient (25°C, with 2.3 litres water) obtained within 70 minutes. Or 45°C within 40 minutes.
<b>Temperature stability</b>	±0.5°C at constant ambient temperature, improved to ±0.25°C when using the lid AZ9241.
<b>Mains Power Lead set (UK) 13A BS1362</b>	3 core earthed / ground. 2 meters long Moulded IEC plug and Lead set – supply cord H05 V V-F- Replace only with equivalent cable.
<b>Mains Power Lead set (Europe)</b>	3 core earthed / ground. 2 meters long Moulded IEC plug and Lead set – supply cord H05 V V-F- Replace only with equivalent cable.
<b>Mains Power Lead set (USA)</b>	3 core earthed / ground. 2 meters long Moulded IEC plug and Lead set – supply cord SJT VW 1- Replace only with equivalent cable.
<b>Lead set plug fuse (UK – only)</b>	13A BS1362
<b>Product Fuse Rating</b>	230V – F1.25A (IEC127) Quick Blow Fuse 20mm x 5mm Glass. 115V – F5A (IEC127) Quick Blow Fuse 20mm x 5mm Glass.
<b>Heating Element</b>	Silicone Rubber Mat Heater.
<b>Over Temperature Protection</b>	Over temperature protection with resettable thermal cut out.
<b>Maximum Bath Capacity</b>	2.3 litres (0.6 US gallon), (0.5 UK gallon).
<b>Case Construction</b>	Aluminium bath with PTFE coated interior. Powder coated aluminium white exterior.
<b>Neon indicators</b>	Power on – Clear Heater on – Amber
<b>Controls: Bath Heater</b>	Electronic temperature controller with thermocouple sensor feedback

The Ingress protection rating for this product is classified as IPX 1.

### 8.2. Dimensions and Weight. (unpacked and empty)

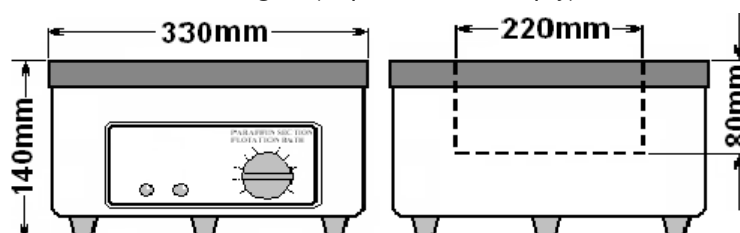

**Weight 2.7Kg**

## 9. MAINTENANCE

### 9.1. General Information.



Unplug the unit from the mains voltage supply and allow it to cool before undertaking any maintenance tasks.



Maintenance should only be carried out under the direction of the Responsible Body, by a competent electrician. Failure to do so may result in damage to the product and in extreme cases be a danger to the end user.

With proper care in operation this equipment has been designed to give many years of reliable service. Contamination or general misuse will reduce the effective life of this product and may cause a hazard.


Maintenance for the unit should include:

- Periodic electrical safety testing (an annual test is recommended as the minimum requirement).
- Regular inspection for damage with particular attention to the mains lead and plug.
- Routine cleaning of the equipment should be undertaken using a clean cloth. Hot water may be used to remove any solidified wax. Allow the equipment to dry thoroughly before reconnecting the to the mains electricity supply.

**DO NOT USE SOLVENTS FOR CLEANING ANY PART OF THIS EQUIPMENT.**

### 9.2. Internal Fuse Replacement.

The mains fuse holder is located at rear your product. Refer to Technical Specification, 'Fuse Rating' for correct fuse type and rating. Turn your product off and remove it from the mains supply. Open fuse draw and remove fuses. Fit replacement fuses and close the draw.

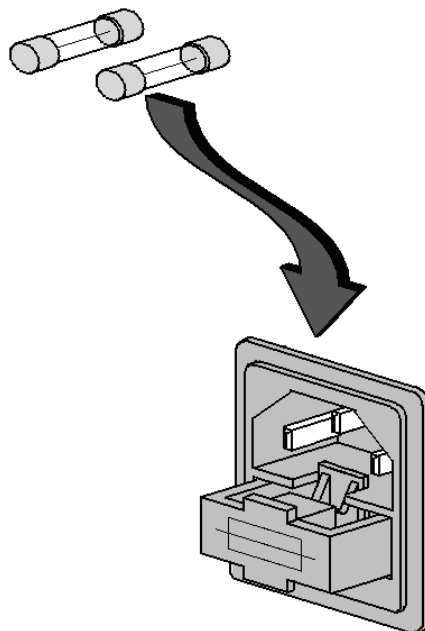

### 9.3. Spillage and Decontamination.

In the event of spillage switch off and unplug this product from the mains electrical supply. Empty the bath and wipe off all excess liquid from the bath and surrounding area using an absorbent soft cloth. Allow sufficient time for any liquid ingress to evaporate (unit can be placed in a warm oven up to 40°C to accommodate drying out).

**Prior to further use, the Responsible Body shall check the electrical safety of the unit. Only if all safety requirements are met can the unit be used again.**

If in doubt please consult Customer Support. Refer to section 10.



**If the equipment has been exposed to contamination, the Responsible Body is responsible for carrying out appropriate decontamination. If hazardous material has been spilt on or inside the equipment, decontamination should only be undertaken under the control of the Responsible Body with due recognition of possible hazards. Before using any cleaning or decontamination method, the Responsible Body should check with the manufacturer the proposed method will not damage the equipment.**

**Prior to further use, the Responsible Body shall check the electrical safety of the unit. Only if all safety requirements are met can the unit be used again. The above procedure is intended as a guide. Should spillage occur with a toxic or hazardous fluid then special precautions may be necessary.**

#### **Decontamination Certificate.**

**Note:** In the event of this equipment or any part of the unit becoming damaged, or requiring service, the item(s) should be returned to the manufacturer for repair accompanied by a decontamination certificate. **Copies of the Certificate are available from Distributor/Manufacturer. Appendix A of this instructions book may be copied and enlarged.**

**At the end of life, this product must be accompanied by a Decontamination Certificate. See section 6.3 and 6.4**

## 10. CUSTOMER SUPPORT

For help and support in using this product, please contact Customer Services at the following address.

**Bibby Scientific Limited.**  
Beacon Road,  
Stone,  
Staffordshire ST15 0SA,  
Great Britain.

Tel: +44(0)1785 812121  
Fax: +44(0)1785 810405

- General enquiries :  
[info@bibby-scientific.com](mailto:info@bibby-scientific.com)
- Order enquiries :  
[sales@bibby-scientific.com](mailto:sales@bibby-scientific.com)
- Technical support :  
[electrothermalhelp@bibby-scientific.com](mailto:electrothermalhelp@bibby-scientific.com)
- Or visit our website:  
[www.electrothermal.com](http://www.electrothermal.com)

For the America's and Canada, contact:

**Techne Incorporated.**  
3 Terri Lane,  
Suite 10,  
Burlington, NJ 08016  
USA.

Toll free:800-225-9243  
Tel: 609-589-2560  
Fax: 609-589-2571

Email: [labproducts@techneusa.com](mailto:labproducts@techneusa.com)

**APPENDIX 'A'. DECONTAMINATION CERTIFICATE.**

<b>Bibby Scientific Limited.</b> Beacon Road, Stone, Staffordshire ST15 0SA. Great Britain Tel: +44(0)1785 812121. Fax: +44(0)1785 810405 <b>E-mail: <a href="mailto:electrothermalhelp@bibby-scientific.com">electrothermalhelp@bibby-scientific.com</a></b>		
<b><u>DECONTAMINATION CLEARANCE CERTIFICATE</u></b>		
For the Inspection, Repair or Return of Medical, Laboratory or Industrial Equipment.		
Prior to a Service Engineer working on equipment that has been in an environment where substances hazardous to health may have been used, you are requested to provide the following information:		
<b>CUSTOMER DETAILS</b>		
Company:-	Address:-	
Department:-		
Contact Name:-		
Tel No:-		
Fax No:-	Post Code:-	
<b><u>Product Description</u></b>		
Model No:-	Serial No:-	
Has the equipment been exposed to any of the following, Please answer all questions by deleting YES/NO as applicable and by providing details in section 2 below.		
A. Blood, body fluids, Pathological specimens	YES/NO	Provide details if YES
B. Biodegradable material that could become a hazard	YES/NO	Provide details if YES
C. Other biohazard	YES/NO	Provide details if YES
D. Chemical or substances hazardous to health	YES/NO	Provide details if YES
E. Radioactive substances State name(s) and quantities of isotopes and checks made for residual activity	YES/NO	Provide details if YES
F. Other hazards	YES/NO	Provide details if YES
2. Please provide details of any hazard present as indicated above. Include details of names and quantities of agents as appropriate:-		
3. Your method of decontamination (please describe):-		
4. Are there likely to be any areas of residual contamination (please specify)		
<b>I declare that the above information is true and complete to the best of my knowledge and belief.</b>		
Authorised signature:-	Name (please print):-	
Title/Position:-		
For and behalf of:-	Date:-	



## 11. SPARES AND ACCESSORIES

	<b>230V</b>	<b>115V</b>	<b>Qty</b>
Lid for MH8156	AZ9241	AZ9241	1

## 12. NOTES.

# Declaration of Conformity

## Paraffin Section Floatation Bath, Model MH8517 & MH8517X1

These products comply with the requirements of the EU Directives listed below:

2004/108/EC	EMC Directive
2006/95/EC	Low Voltage Directive (LVD)

Compliance with the requirements of these Directives is claimed by meeting the following standards:

EN 61326-1: 2006	Electrical Equipment for Measurement, Control and Laboratory use
EN 61010-1: 2010	Safety Requirements Electrical Equipment for Measurement, Control and Laboratory use
EN 61000-3-2: 2006 + A2: 2009	Limits for harmonic current emissions (equipment input current $\leq 16A$ per phase)
EN 61000-3-3: 2008	Limitation of voltage fluctuations and flicker in low voltage supply systems for equipment with rated current $\leq 16A$

Compliance Certificates and Equipment Specification.

CE mark affixed '14

Signed:  (Mr S. Marriott)

Date: 5/3/14

Authority: Technical Director  
Bibby Scientific Ltd

 Bibby Scientific Ltd - Stone - Staffs - ST15 0SA - UK  
Tel: +44 (0) 1785 812121 - Fax +44 (0) 1785 813748



Thank you for reading this data sheet.

For pricing or for further information, please contact us at our UK Office, using the details below.



**UK Office**

**Keison Products,**

**P.O. Box 2124, Chelmsford, Essex, CM1 3UP, England.**

**Tel: +44 (0)330 088 0560**

**Fax: +44 (0)1245 808399**

**Email: [sales@keison.co.uk](mailto:sales@keison.co.uk)**

Please note - Product designs and specifications are subject to change without notice. The user is responsible for determining the suitability of this product.